



सत्यमेव जयते

वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई
INSTITUTE FOR DESIGN OF ELECTRICAL
MEASURING INSTRUMENTS, MUMBAI
MSME TECHNOLOGY CENTRE



संदर्भ सं / Ref. No.: WO/ETL/032/25-26

दिनांक : 02.07.2025
Date :

M/s. SELEC CONTROLS PVT. LTD.,
EL-27/1, ELECTRONIC ZONE,
TTC INDUSTRIAL AREA, MAHAPE,
NAVI-MUMBAI
MAHARASHTRA, INDIA

Kind Attn: **Mr. Karan Rawlani**

विषय : परीक्षण रिपोर्ट

Sub : **Test Report**

महोदय,

आपके उपकरणों / अवयवों पर किये हुये परीक्षण रिपोर्ट संख्या (**TR/ETL/083/25-26**) आपको जानकारी के लिए पत्र के साथ भेज रहे हैं। यदि आपको परीक्षित मर्दों पर स्पष्टीकरण की कोई आवश्यकता हो तो, कृपया परीक्षण रिपोर्ट जारी करने वाले प्राधिकारी को हमारे संदर्भ संख्या और तारीख का उल्लेख करते हुए, रिपोर्ट प्राप्त होने पर चार सप्ताह के अंदर सम्पर्क करें अथवा लिखें। हम इस पत्र के साथ फीडबैक फॉर्म भेज रहे हैं। कृपया उसे भरके प्रधान निदेशक, वैमाउअसं मुंबई को भेजें।

Dear Sir,

Test Report No. (**TR/ETL/083/25-26**) of your instruments / components / Equipments are / is enclosed herewith for your information. If you need any clarification on Test Report, please write / contact to Test Report issuing officer quoting our reference number and date within four weeks from the date of receipt of this report. We are also enclosing here with the feedback form. Kindly fill up and send to the Principal Director of IDEMI Mumbai.

धन्यवाद !

Thanking You,

भवदीय

Yours Faithfully

संलग्न पत्रानुसार
Encl. As Above

प्रधान निदेशक
PRINCIPAL DIRECTOR

Swatantryaveer Tatya Tope Marg, Chunabhatti, Sion. P.O. Mumbai - 400 022 (M.S)

Phone:(022) - 2405 0301/2/3/4 , 2405 6239 | Fax:(022) - 2405 0016

Website :www.idemi.org | Email: etl@idemi.org

FF-LAB-017



सत्यमेव जयते

TEST REPORT



TC-5538

Accreditation Field : Electrical Testing
Group : Environmental Testing Facility
NABL Accreditation No.: TC-5538
Accreditation Valid Up to: 23.04.2026
Date of Receipt: 07.05.2025
ULR No : TC55382500000203F

Work Order No. : WO/ETL/032/25-26
Date : 07.05.2025
Test Report No. : TR/ETL/083/25-26
Date of Testing : 02.06.2025 to 11.06.2025
Date of issue : 02.07.2025
Page No.: 1 of 7

Test Item : Protection Relay

Tested for : M/s. Selec Controls Pvt. Ltd.,
EL-27/1, Electronic Zone, TTC Industrial Area, Mahape, Navi-Mumbai – 400 710,
Maharashtra, India

Tested at : IDEMI MUMBAI

Specification of Items Under Test	Specification of Standards Used
<p>Manufacturer: M/s. Selec Control Pvt. Ltd.,</p> <p>Condition of Item on Receipt: Good</p> <p>Range / Rating: Vn: 415A AC, V : 310 – 520V AC VA : 20VA, NO / 5A, NC/3A, 250V AC 50/60Hz Trip Delay: 0.2 to 10s Under Voltage : 310 – 405V AC Over Voltage : 425 – 520V AC</p> <p>Model No.: 600VPR-310/520V-CE Sr. No.: S#2503T005075720077</p>	<p>1 Vibration/Shock Test System</p> <p>i. Digital Vibration Controller Model No.: SPARK USB, Sr. no.: 10652 Calibration Validity: May 2026</p> <p>ii. Charge Accelerometer Model No.: 357BO3, Sr. no.: 28580 Calibration Validity: Jan 2026</p> <p>Traceability: Standard used are traceable to National / International Standards</p>

Ambient Conditions :

Temperature: $28^{\circ}\text{C} \pm 2^{\circ}\text{C}$

Relative Humidity: $< 75\%$

Atmospheric Pressure: $1008 \text{ to } 1009 \text{ mbar}$

Remarks: Please refer page 3 to 7 for Test Results.

1) Test Specification: The above mentioned item is tested for

1. Functional Random Vibration Test
2. Random Vibration Test (Simulated Long Life Test)
3. Shock Test

as per IEC 61373 : 2010 & as per customer requirement



C. M. PATIL

TECHNICAL MANAGER

REVIEWED & AUTHORISED SIGNATORY

Note : This test reports only to the particulars item(s), submitted for testing. The test reports should not be reproduced except in full without the prior permission from the Principal Director, IDEMI, Mumbai. This test report is signed by authorized signatory approved by NABL.

वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई

INSTITUTE FOR DESIGN OF ELECTRICAL MEASURING INSTRUMENTS, MUMBAI

सूक्ष्म, लघु और मध्यम उद्यम मंत्रालय, भारत सरकार

Ministry of Micro, Small & Medium Enterprises, Govt. of India.

स्वातंत्र्यवीर तात्या टोपे मार्ग, चुनाभट्टी, सायन डाकघर, मुंबई - ४०० ०२२.

Swatantryaveer Tatyta Tope Marg, Chunabhatti, Sion P.O. Mumbai - 400 022

IDEMI

FF-LAB-007



वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई
**INSTITUTE FOR DESIGN OF ELECTRICAL
MEASURING INSTRUMENTS, MUMBAI**



सत्यमेव जयते

ELECTRICAL TESTING LABORATORY

Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC553825000000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 2 of 7

DISCIPLINE : Electrical
GROUP : Environmental Testing Facility

1. EQUIPMENT UNDER TEST (EUT)

1.1 Brief Description (Declared by Mfg.)

Basic Functions:

- 3-Phase Voltage Monitoring.
- Under Voltage Protection.
- Over Voltage Protection.
- Phase Sequence Detection.
- Phase Failure Detection.
- Asymmetry (Unbalance) Detection.

Feature:

- Operating Voltage Range: 310–520V AC (L-L), 3-phase, 50/60Hz
- Output Relay Contact: 1 C/O (Changeover), used for tripping or control
- LED Indication: For Power ON, Relay status, and Fault conditions
- Trip Delay & Reset Delay: Adjustable time delays to avoid nuisance tripping
- DIN Rail Mounting: Compact and easy to install in control panels
- CE Marked: Meets CE standards for safety and electromagnetic compatibility

Uses and Application:

- Protection of motors and compressors
- Control panels in industrial automation
- Elevator control panels
- HVAC systems
- DG and transformer protection

1.2 Functional / performance test before & after the test

The EUT shall not get any mechanical damage or any degradation in the performance of the EUT.

DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538



ELECTRICAL TESTING LABORATORY

Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC55382500000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 3 of 7

2. FUNCTIONAL RANDOM VIBRATION TEST

a. Test Rationale:

The functional random test levels are the minimum test levels to be applied in order to demonstrate that the equipment under test is capable of functioning when subjected to conditions which are likely to occur in service, on railway vehicles.

b. Test Condition:

Test method : IEC 61373:2010 (Category 1, Class B)
Frequency : 5 – 150 Hz
Acceleration : Vertical : 1.01 m/s²
Transverse : 0.45 m/s²
Longitudinal : 0.70 m/s²
Direction : X, Y, Z axis
Duration : 10 mins. at each axis
EUT Condition : EUT Energized condition with 415V AC 50Hz

c. Requirements:

The EUT shall not get any mechanical damage or any degradation in the performance of the EUT.

d. Observation:

No mechanical damage or any degradation was observed during & after the test. The performance of the EUT was found to be satisfactory after the test.

e. Result:

Complied

DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538



ELECTRICAL TESTING LABORATORY

Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC553825000000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 4 of 7

3. RANDOM VIBRATION TEST (SIMULATED LONG LIFE TEST)

a. Test Rationale:

This test is aimed at establishing the mechanical integrity of the equipment at increased service levels.

b. Test Condition:

Test method : IEC 61373 : 2010 (Category 1, Class B)
Frequency : 5 – 150 Hz
Acceleration : Vertical : 5.72 m/s²
Transverse : 2.55 m/s²
Longitudinal : 3.96 m/s²
Direction : X, Y, Z axis
Duration : 5 Hrs. at each axis
EUT Condition : EUT in de-energized Condition

c. Requirements:

The EUT shall not get any mechanical damage or any degradation in the performance of the EUT.

d. Observation:

No mechanical damage or any degradation was observed during & after the test. The performance of the EUT was found to be satisfactory after the test.

e. Result:

Complied

DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538



सत्यमेव जयते

वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई
**INSTITUTE FOR DESIGN OF ELECTRICAL
MEASURING INSTRUMENTS, MUMBAI**



ELECTRICAL TESTING LABORATORY

Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC553825000000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 5 of 7

4. SHOCK TEST

a. Test Rationale:

To determining the ability of a specimen to withstand specified severities of non-repetitive or repetitive shocks

b. Test Condition:

Test method : IEC 61373:2010 (Category 1, Class B)
Waveform : Half Sine
Acceleration : Vertical : 30.0 m/s²
Transverse : 30.0 m/s²
Longitudinal : 50.0 m/s²
Pulse Width : 30 ms
No of Shock : ± 3 per Axis
Direction : X, Y, Z axis
EUT Condition : EUT in De-energized condition

c. Requirements:

The EUT shall not get any mechanical damage or any degradation in the performance of the EUT.

d. Observation:

No mechanical damage or any degradation was observed during & after the test. The performance of the EUT was found to be satisfactory after the test.

e. Result:

Complied

DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538



सत्यमेव जयते

वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई
INSTITUTE FOR DESIGN OF ELECTRICAL
MEASURING INSTRUMENTS, MUMBAI




ELECTRICAL TESTING LABORATORY

Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC553825000000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 6 of 7

Test setup Photograph

X – Axis

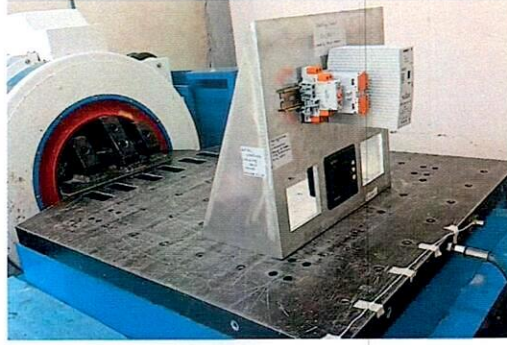

Y – Axis



Z – Axis



DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538



सत्यमेव जयते

वैद्युतिक मापन उपयंत्र अभिकल्प संस्थान, मुंबई INSTITUTE FOR DESIGN OF ELECTRICAL MEASURING INSTRUMENTS, MUMBAI




ELECTRICAL TESTING LABORATORY


Model No.: 600VPR-310/520V-CE
Sr. No.: S#2503T005075720077
Date of Testing : 02.06.2025 to 11.06.2025

ULR No.: TC553825000000203F
Test Report No.: TR/ETL/083/25-26
Page No.: 7 of 7

EUT Photographs

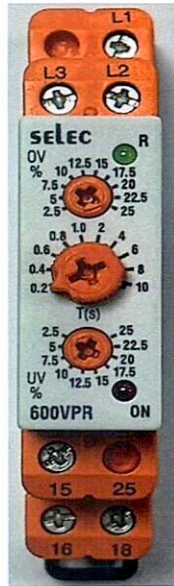

Marking Plate

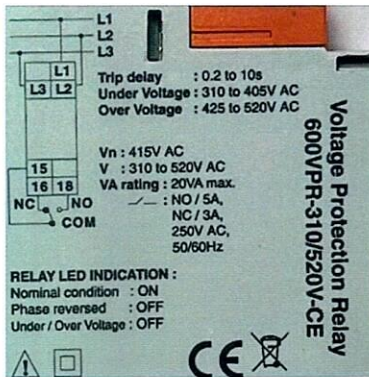

*** END OF TEST REPORT ***

DURGESH AMBEKAR
DY. TECHNICAL MANAGER
TESTED BY

C. M. PATIL
TECHNICAL MANAGER
CHECKED BY



TC-5538