

ASTA Certificate

of Selected Type Tests

Laboratory Ref. No: WO-1718-004630/ERDA-00204218

APPARATUS: 4000/5 A, 0.72kV (U_m), 40kA/1Sec, Burden 15VA, Class 0.5, 50Hz, encapsulated window type current transformer with one secondary winding.

DESIGNATION: SPCT

MANUFACTURER: Selec Controls Pvt. Ltd.
EL-27/1, Electronic Zone, TTC Industrial Area, MIDC, Mahape,
Navi Mumbai – 400 710, INDIA.

TESTED BY: Electrical Research & Development Association
ERDA Road, Makarpura Industrial Estate, Vadodara-390 010,
Gujarat, INDIA.

DATE(S) OF TESTS: 14th June 2017 to 28th September 2017

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this certificate has been subjected to the series of proving tests in accordance with

IEC 61869-2 Edition 1.0 2012-09, IEC 61869-1 Edition 1:0 2007-10 and BS EN 61869-2:2012 Clauses 7.2.201, 7.2.6.201, 7.2.6.202, 7.3.1, 7.3.4, 7.3.6 and 7.3.204 and the STL Guide to 61869-2:2012 Issue 1.1, 1st July 2016

For ratings assigned by the manufacturer and proven by tests see page 1

The results are shown in the record of Proving Tests attached hereto. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s). This Certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.

This Certificate comprises this front sheet, 1 rating(s) page plus 19 other pages and 3 drawings as detailed on page 3

Only integral reproductions of this whole certificate or reproductions of this page accompanied by any ratings pages are permitted.

Issued by Intertek, Centre Court, Meridian Business Park, Leicester, LE19 1WD England. Contact: asta@intertek.com Tel: +44 (0)116 263 0330



010


C. Diack-Evans C Diack-Evans
ASTA Observer

R. Hayward Certification
Manager


7th September 2018 Date

1 2 3 4 5 6


SPCT 62/30

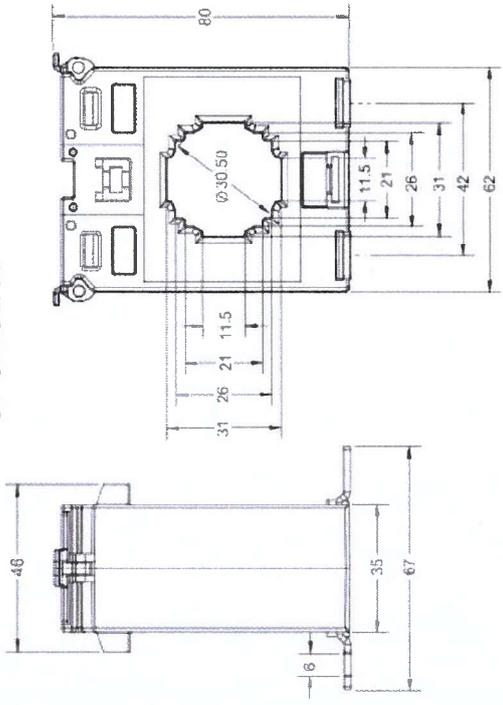


SPCT 100/60

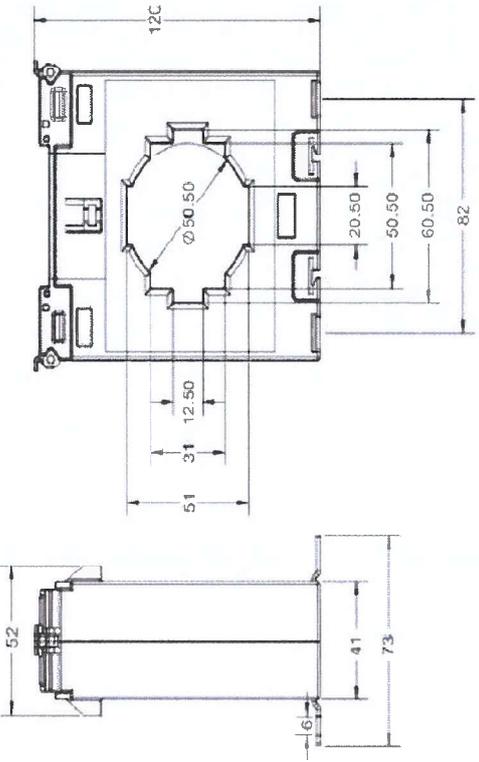

SPCT 62/40

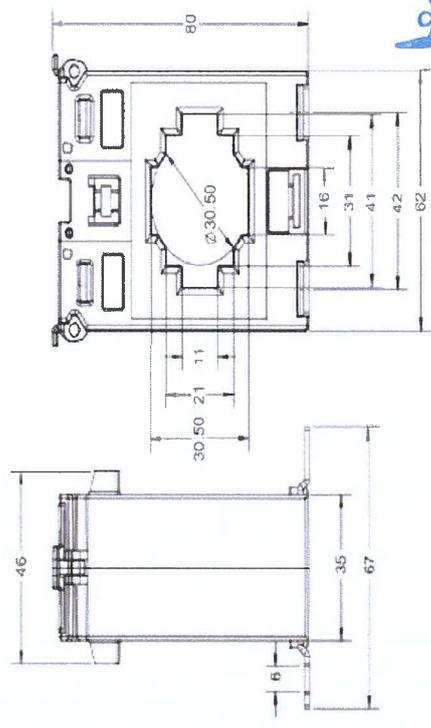

SPCT 140/100

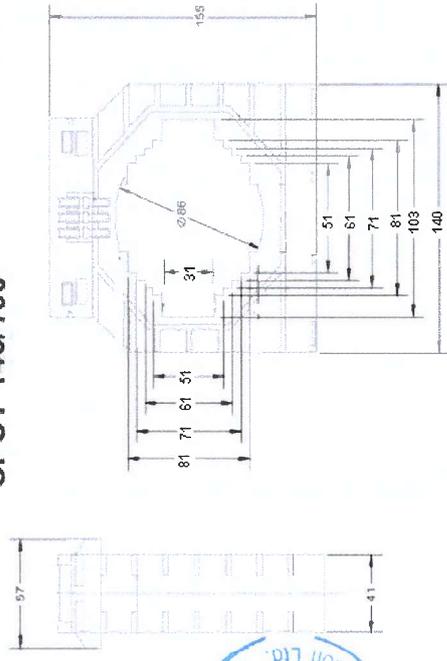

Handwritten signature

ALL DIMENSION ARE IN mm.

LINEAR TOLERANCE : ± 2 mm

ANGULAR TOLERANCE: $\pm 1^\circ$
The information in this drawing is sole property of SELEC CONTROLS PVT. LTD. any reproduction in part or as a whole without written permission of SELEC CONTROLS PVT. LTD. is prohibited

SELEC Controls Pvt. Ltd. | SHEET 1 OF 1 | SCALE: NTS | DATE: 21/04/17

REV: 01

DRAWN: V M

CHKD: V M

APPVD: NKS

DWG NO: HYSP_OA02_1718



DIE NO: NA

HARDNESS: NA

PLATING: NA

TITLE: HYCT & SPCT SERIES PART 2